Gas Regulator Station
Field Inspections

CS421034

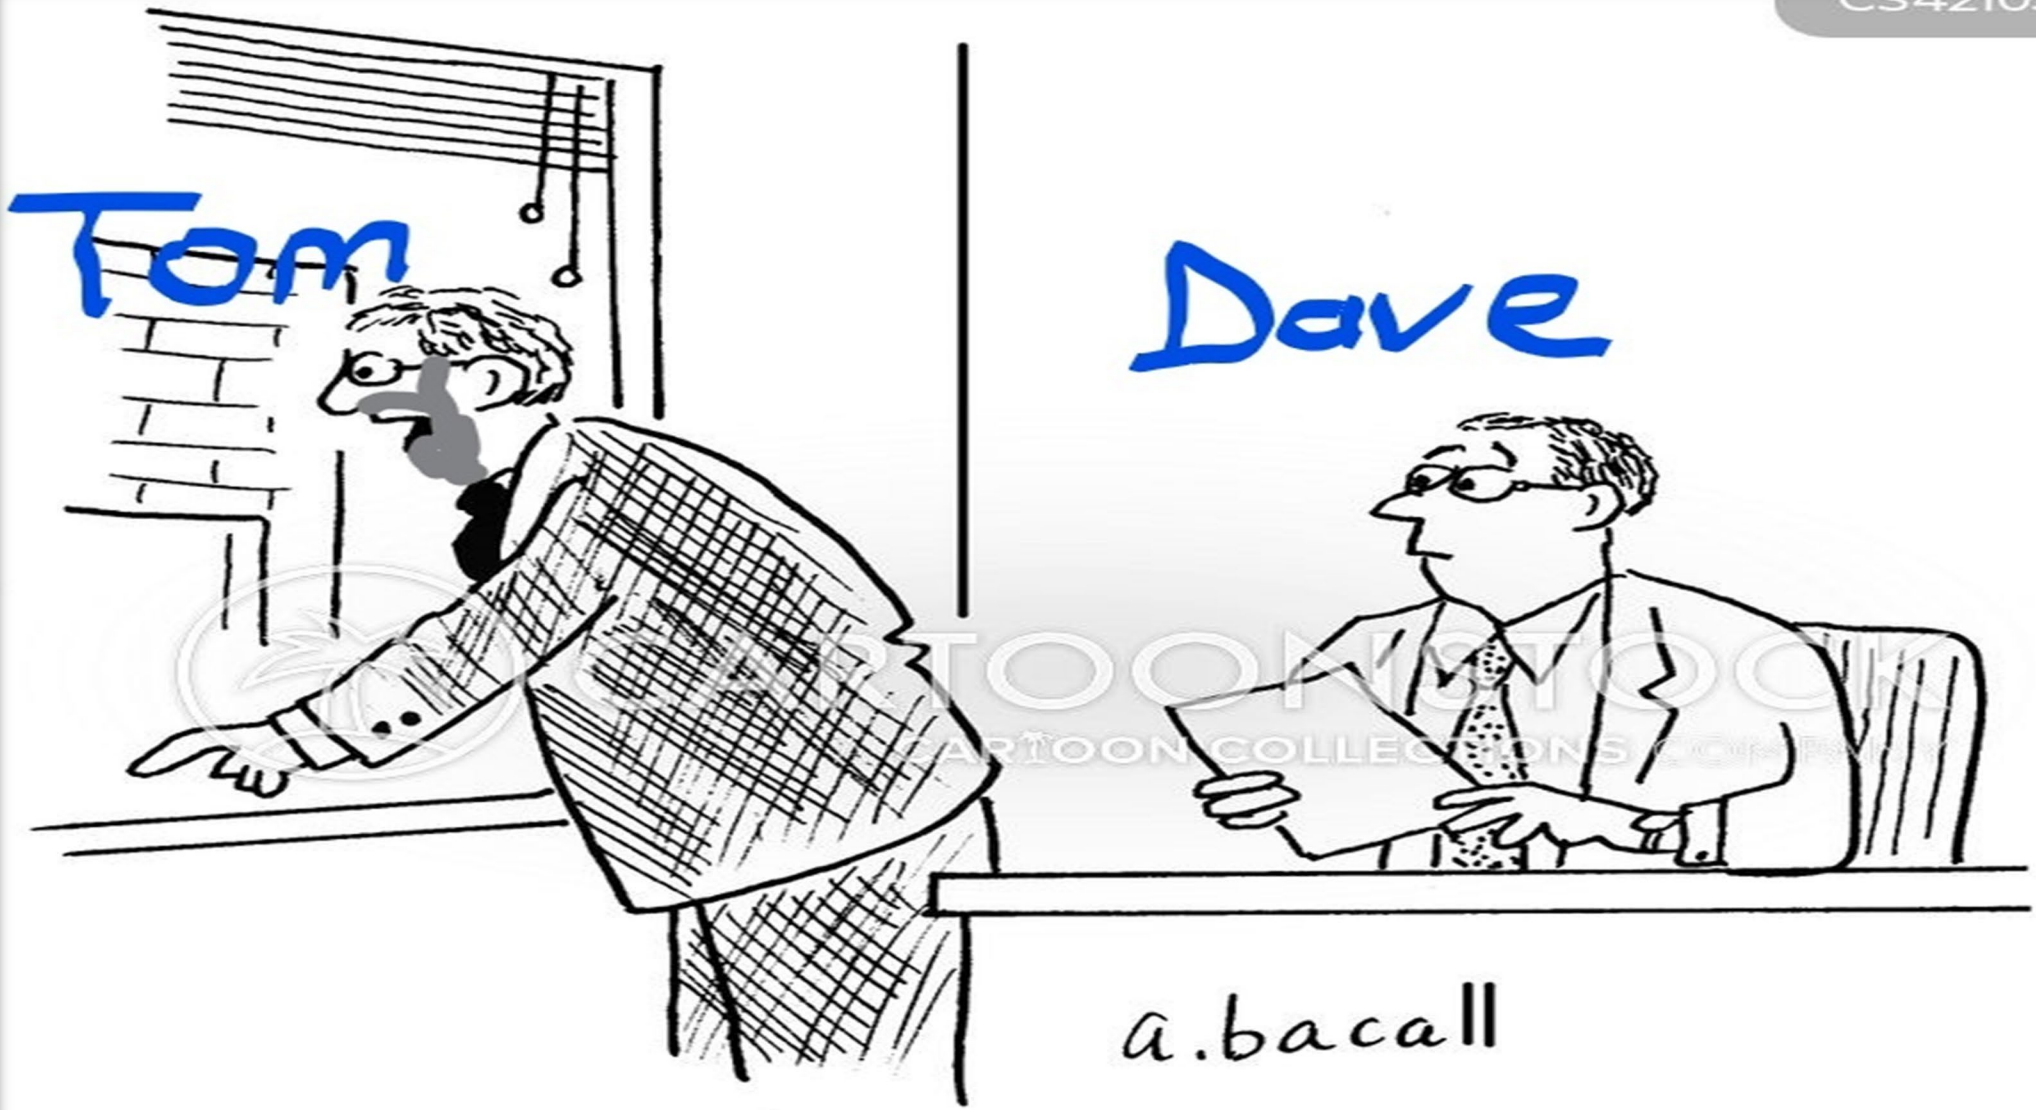

"There's a moving truck backing up to our loading dock. Maybe they're delivering the government regulatory guidelines."

Inventory Record Card

- **Verify that information on Inventory Record Card matches actual contents of Regulator Station.**
- **Verify that records in office match information on Inventory Record Card.**

§192.605(b)(3)

Inspection Items

- **Regulator make and model**
- **Size of regulator**
- **Capacity**
- **Set pressure**
- **MAOP – inlet and outlet**
- **Point of demarcation**
- **Function – (Monitor/control)**

§192.739

461 – 57S – Medium Pressure

461-S Low Pressure

Axial Flow - Low, Medium & High Pressure

Fisher 630 – Big Joe High Pressure

Relief Valves

- **Set point**
- **Where vented – (inside, to atmosphere)**
- **Rain caps**
- **Protection from unauthorized operation**
- **Capacity**

§192.739 & 192.743

GAS
PIPELINE
GAS

Rain Cap

Overall Condition

- **Is it cathodically protected? Insulated?**
- **Is there atmospheric corrosion?**
- **Building or fencing**
- **Proper signage and markers**
- **Shared facilities**
- **Demarcation**

Signs and Markers

- **Is the regulator station properly marked and identified?**
- **Warning or Caution**
- **Prevention of accidental ignition**

§192.707 & 192.751

Station ID

Dominion Energy
Dominion Energy West Virginia
Meadowbrook Road Station
LS-2269
Warning - Natural Gas Pipeline
For Emergency Call 1-800-688-4673

Warning

Mountaineer Gas Company
DANGER
NO TRESPASSING!
DANGER
Mountaineer Gas

Fencing

Mountaineer Gas Company
DANGER
HIGH PRESSURE NATURAL GAS PIPELINE
DAMAGE TO THIS PIPELINE MAY RESULT
IN DEATH OR SERIOUS BODILY INJURY.
PURSUANT TO WV CODE § 55-7-27,
MOUNTAINEER GAS COMPANY ASSUMES
NO LIABILITY FOR DEATH OR INJURY
SUSTAINED AS A RESULT OF TRESPASS.
NO TRESPASSING!
In case of emergency, call 1-800-534-2070 or call 911

bfs foods
2831
3091

DANGER
NATURAL GAS
NO SMOKING
OR OPEN
FLAMES

Monitoring and/or Control

- **Telemetering**
- **Recording gage**
- **Indicating gage**
- **Is system supplied by more than one District Regulator?**

§192.741(a)

Critical Valves

- **Distance from inlet riser**
- **Is it accessible?**
- **Is it operable?**

§192.181

WARNING
GAS PIPELINE

Other Information

- **Separator, odorizer, dryer, heater, etc?**
- **General comments of observation, if any**

"You regulators are never satisfied. You wanted more transparency, so we put more windows in the building."

Contact Information

Jim Searls

Gas Pipeline Safety Inspector

PSC of WV

(304)382-6168

jsearls@psc.state.wv.us